






Art- 63521-522-532 -- Art- 63321 - 322 - 332
 Intem - 63521-522-532--Intem-63321 - 322 - 332

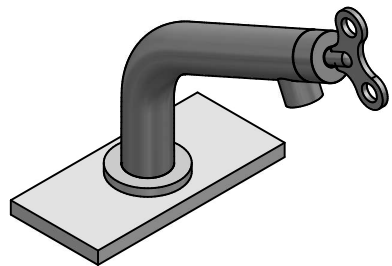

Art- 64521-522-532
 Intem - 64521-522-532

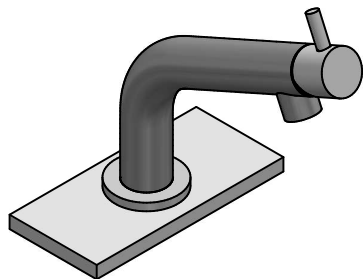

SOSTITUZIONE AERATORE - REPLACEMENT AERATOR
 Art- 63521-532 -- Art- 63321-332 -- Art-64521-32
 Intem - 63521-532--Intem-63321-332 -- Intem 64521-32

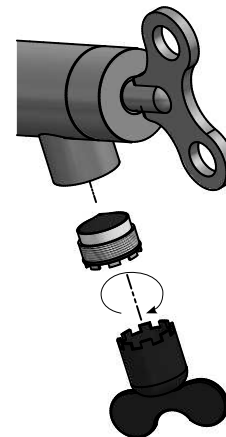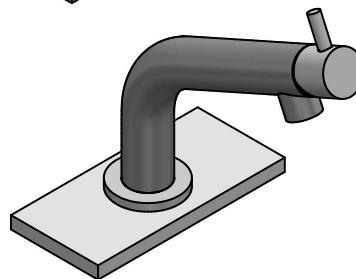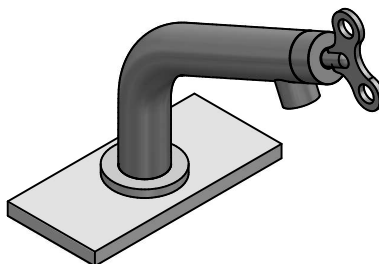

PRESSIONE MINIMA DI SERVIZIO :.....0,5 bar
 PRESSIONE DI SERVIZIO MASSIMA :.....5 bar
 PRESSIONE D'USO CONSIGLIATA :.....3 bar
 TEMPERATURA ACQUA CALDA MAX :.....80°C
 TEMPERATURA ACQUA CALDA CONSIGLIATA :.....60°C

In caso di pressione d'esercizio superiore a 5 bar è consigliabile installare un riduttore di pressione sulle tubature di alimentazione.

MINIMUM WORKING PRESSURE:.....0,5 bar
 MAX OPERATING PRESSURE :.....5 bar
 RECOMMENDED OPERATION PRESSURE :.....3 bar
 MAX HOT WATER TEMPERATURE :.....80°C
 RECOMMENDED HOT WATER TEMPERATURE :.....60°C

In case of operating pressures higher than 5 bar it is recommended to install a pressure reducer on the feeding tubes.

bongio